

SR_ ROOF PANEL CLIP W/
 () ¼ - 14 x 2" TEK 3 W/O WASHER
 PER CLIP, PER PANEL AT EACH LAP
 SECONDARY SUPPORT

¼ - 14 x 7/8" STITCH
 TEKS 2 ½" O/C AT LAP


NOTE: BUTYL SEALANT
 AND BUTYL TAPE TO RUN
 ACROSS FULL WIDTH OF
 PANELS; NOT SHOWN AT
 HIGH RIBS FOR CLARITY.

1" x 3/16" BUTYL TAPE SEALANT

FACTORY-APPLIED FOAM GASKET
 AT UNDERSIDE OF SR ROOF CLIP

SUPPORT ANGLE AND
 FASTENERS BY OTHERS
 (NOT BY IMP SUPPLIER)

SR ROOF PANEL ENDLAP (SECTION VIEW)

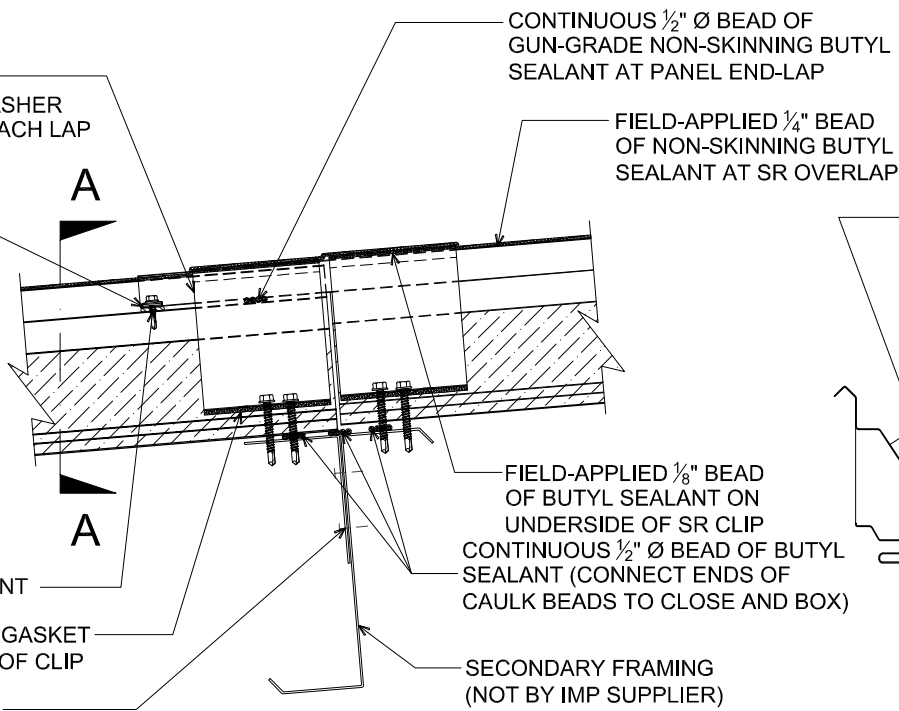


CONTINUOUS ½" Ø BEAD OF
 GUN-GRADE NON-SKINNING BUTYL
 SEALANT AT PANEL END-LAP

FIELD-APPLIED ¼" BEAD
 OF NON-SKINNING BUTYL
 SEALANT AT SR OVERLAP

FIELD-APPLIED ⅛" BEAD
 OF BUTYL SEALANT ON
 UNDERSIDE OF SR CLIP
 CONTINUOUS ½" Ø BEAD OF BUTYL
 SEALANT (CONNECT ENDS OF
 CAULK BEADS TO CLOSE AND BOX)

SECONDARY FRAMING
 (NOT BY IMP SUPPLIER)

NOTE: REFER TO SECTION 13.7 ON
 THE SR2 INSULATED ROOF PANELS
 GENERAL INSTALLATION GUIDE
 FOR ADDITIONAL INFORMATION.

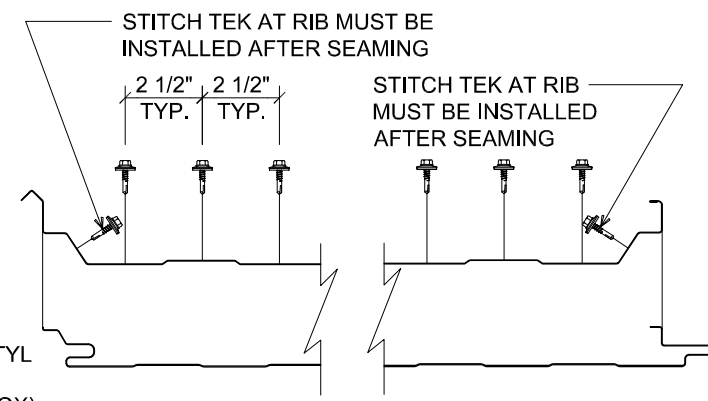

SECTION A-A

NOTE: DO NOT OVER-DRIVE FASTENERS. IF THE METAL AT THE EDGE OF THE
 PANEL IS DEFORMED OUT OF PLANE, THE ADJACENT PANEL WILL BE DIFFICULT TO
 ENGAGE AND WILL NOT SEAM. AFTER SR CLIP HAS BEEN INSTALLED OVER MALE
 LEG OF STANDING SEAM PANEL, PRE-CRIMP, USING ½" HAND CRIMPING TOOL.

DETAIL: ENDLAP

929 ALDRIDGE ROAD
 VACAVILLE, CA 95688
 TEL: (707) 359-2280
 FAX: (707) 359-2286
 WWW.AWIPANELS.COM



APPLICATION:
 SR ROOF, COMMERCIAL & INDUSTRIAL, COLD-STORAGE, COLD-CLIMATE
 AWIP DETAIL NUMBER:
 SRR-CICSCC-EL-001

DATE:
 01/08/20
 DRAWN BY:
 MMF

SHEET:
 1
 OF
 1